





UH-30, -45

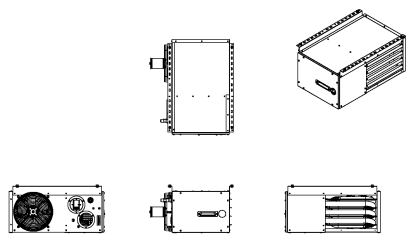

UH-60(-SS), -75

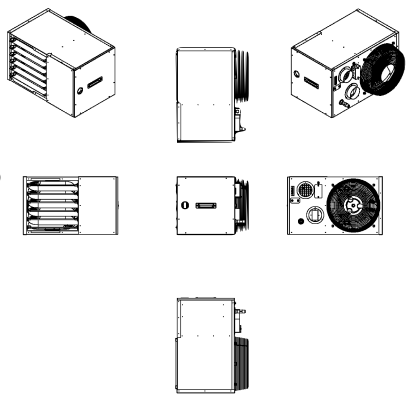


 DETROIT RADIANT PRODUCTS 21400 HOOVER RD WARREN, MI 48089		
DETAILS: UH-30 TO -75 SERIES BLOCKS		
DRAWN BY: DRP	SCALE: 1:1	PROJECT:
CHECKED BY:	DATE: APRIL 2025	DRAWING NO: 1

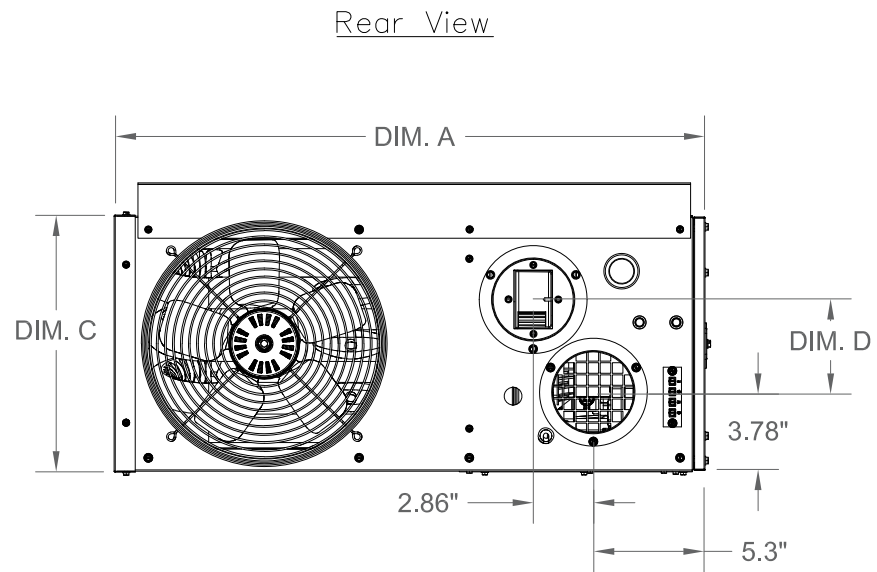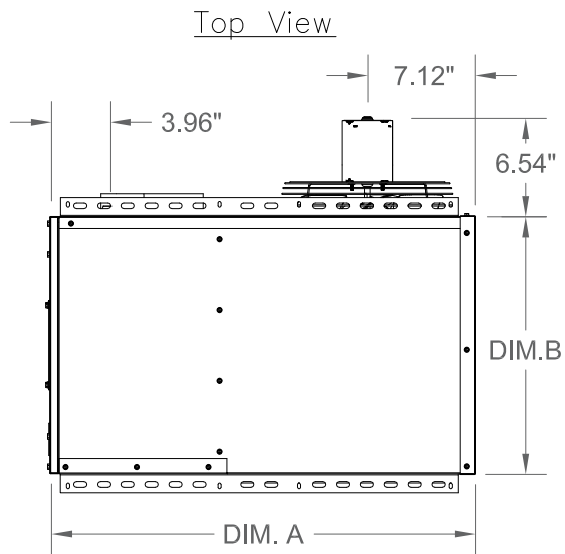


MODEL NO.	HEATER WIDTH DIM. A	HEATER DEPTH DIM. B	HEATER HEIGHT DIM. C	AIR TO VENT DIM. D
UH-30	28 in.	17 in.	12 in.	4.4 in.
UH-45	28 in.	17 in.	12 in.	4.4 in.
UH-60	28 in.	17 in.	17 in.	7.4 in.
UH-75	28 in.	17 in.	17 in.	7.4 in.

 DETROIT RADIANT PRODUCTS 21400 HOOVER RD WARREN, MI 48089		
DETAILS: UH SERIES - HEATER DIMENSIONAL DATA		
DRAWN BY:	SCALE:	PROJECT:
DRP	NTS	
CHECKED BY:	DATE:	DRAWING NO:
	SEPT. 2024	1

Heater Mounting Details

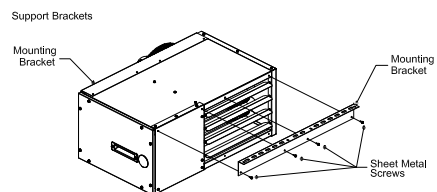


Sidewall Venting Requirements

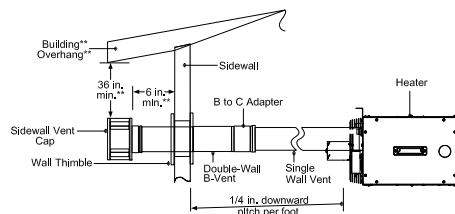


**Vent must extend beyond any combustible overhang if the vent is less than 36 in. below the combustible overhang.

Concentric Venting – Side View

Outside Combustion Air Sidewall Intake

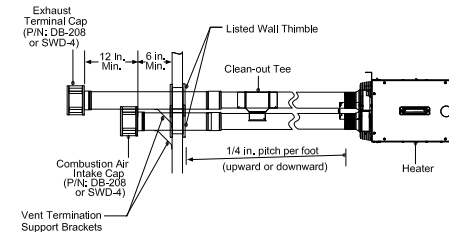


Rooftop Venting Requirements

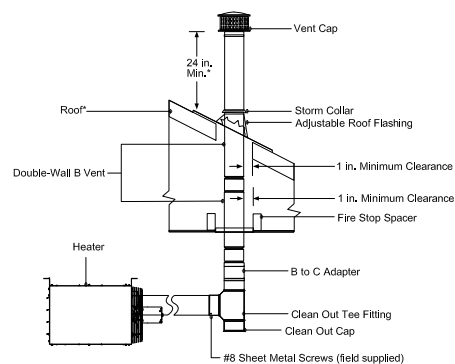


*Consult the NFPA ANSI Z223.1 Gas Vent Termination criteria if roof pitch exceeds 9:12.

Common Rooftop Venting – Side View

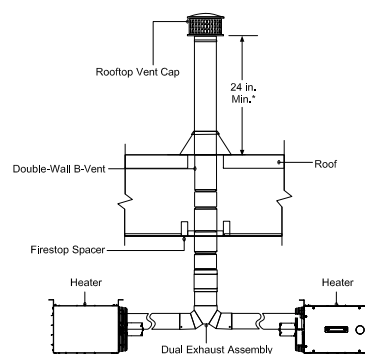

*Consult the NFPA ANSI Z223.1 Gas Vent Termination criteria if roof pitch exceeds 9:12.

Outside Combustion Air Vertical Intake

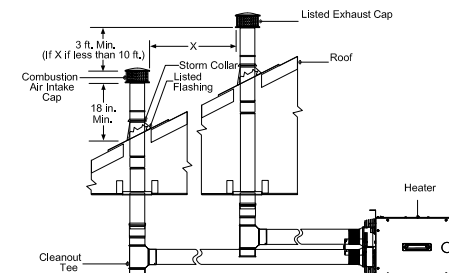

 DETROIT RADIANT PRODUCTS 21400 HOOVER RD WARREN, MI 48089		
DETAILS: UH SERIES - HEATER MOUNTING & VENTING DETAILS		
DRAWN BY:	DRP	SCALE: NTS
CHECKED BY:	DATE: SEPT. 2024	PROJECT: DRAWING NO: 1